


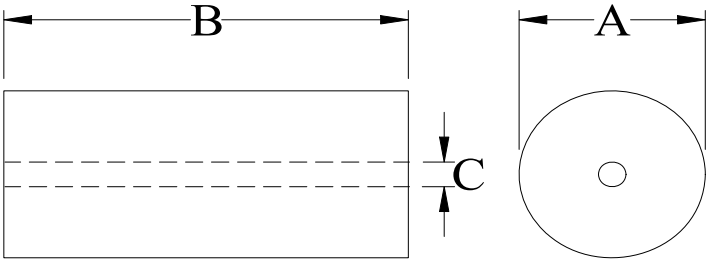

# SPECIFICATION FOR APPROVAL

COMMODITY	<b>RH CORE</b>	SPEC NO.	SP-081203003
ITEM	<b>K5A RH 14.2×7.2×28.5</b> <span style="border: 1px solid black; padding: 2px; font-size: small;">Green</span>	版本：A	表單編號：QR-012-02

(1) DIMENSION: (UNIT: mm)		DIM.	TOL.	
	A	14.20	± 0.50	
	B	28.50	± 0.80	
	C	7.20	± 0.50	

(2) ELECTRICAL CHARACTERISTIC	TEST INSTRUMENTS.
IMPEDANCE at Z1	70 (min.) Ω
IMPEDANCE at Z2	170 (min.) Ω
TEST FREQUENCY at Z1	25 MHz
TEST FREQUENCY at Z2	100 MHz

AGILENT 4294A Precision Impedance Analyzer.  
 AGILENT 4285A Precision L.C.R.  
 HP-4286A RF L.C.R. Meter.  
 ZENTECH 3302 Automatic Components Analyzer.  
 ZENTECH 101 L.C.R. Meter.  
 WAYNE KERR 6420 Precision Impedance Analyzer.  
 ZENTECH 1320 BIAS CURRENT.  
 ZENTECH 502AC Resistance Merter.  
 ADEX AX-1155B DC Low Ohm Meter.


REMARK :  
 . Winding : Φ 0.65 × 100 mm 2UEW 1Ts

PURCHASER CONFIRMED :	APPROVED	CHECKED	DRAWN
			

# TEST REPORT

SPEC NO : SP-081203003

Typical Impedance v.s. Frequency Curve

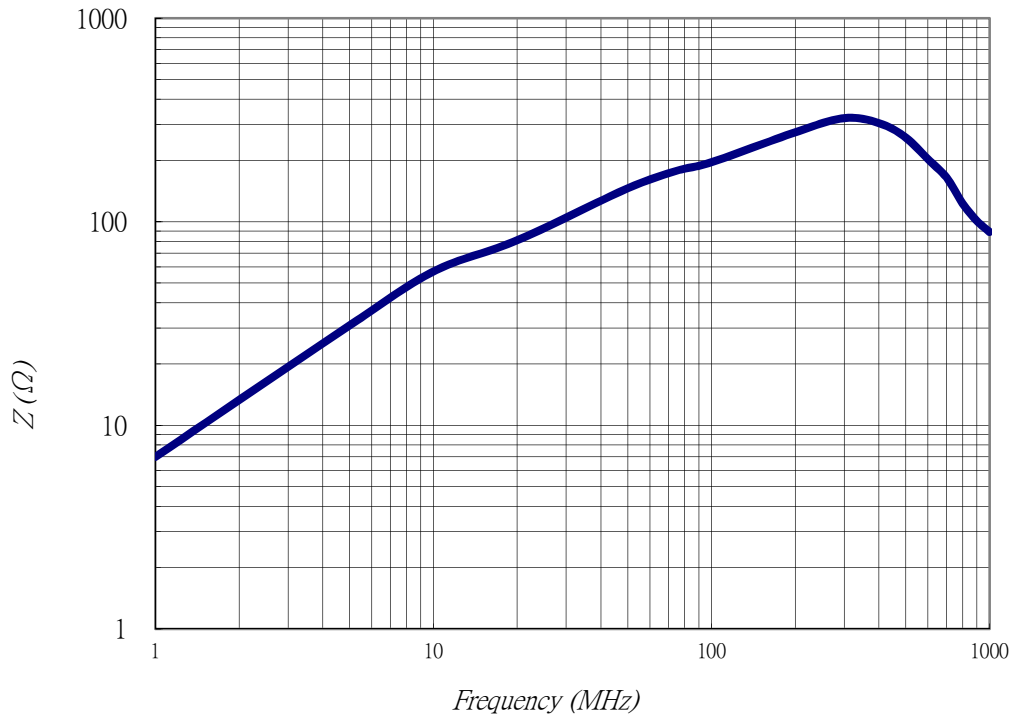

Test Instrument :

HP-4286A RF L.C.R. Meter.

Testing Condition :

Temperature : 25 to 28°C

Humidity : 60 to 70 % RH

Check by :



Test by :

